


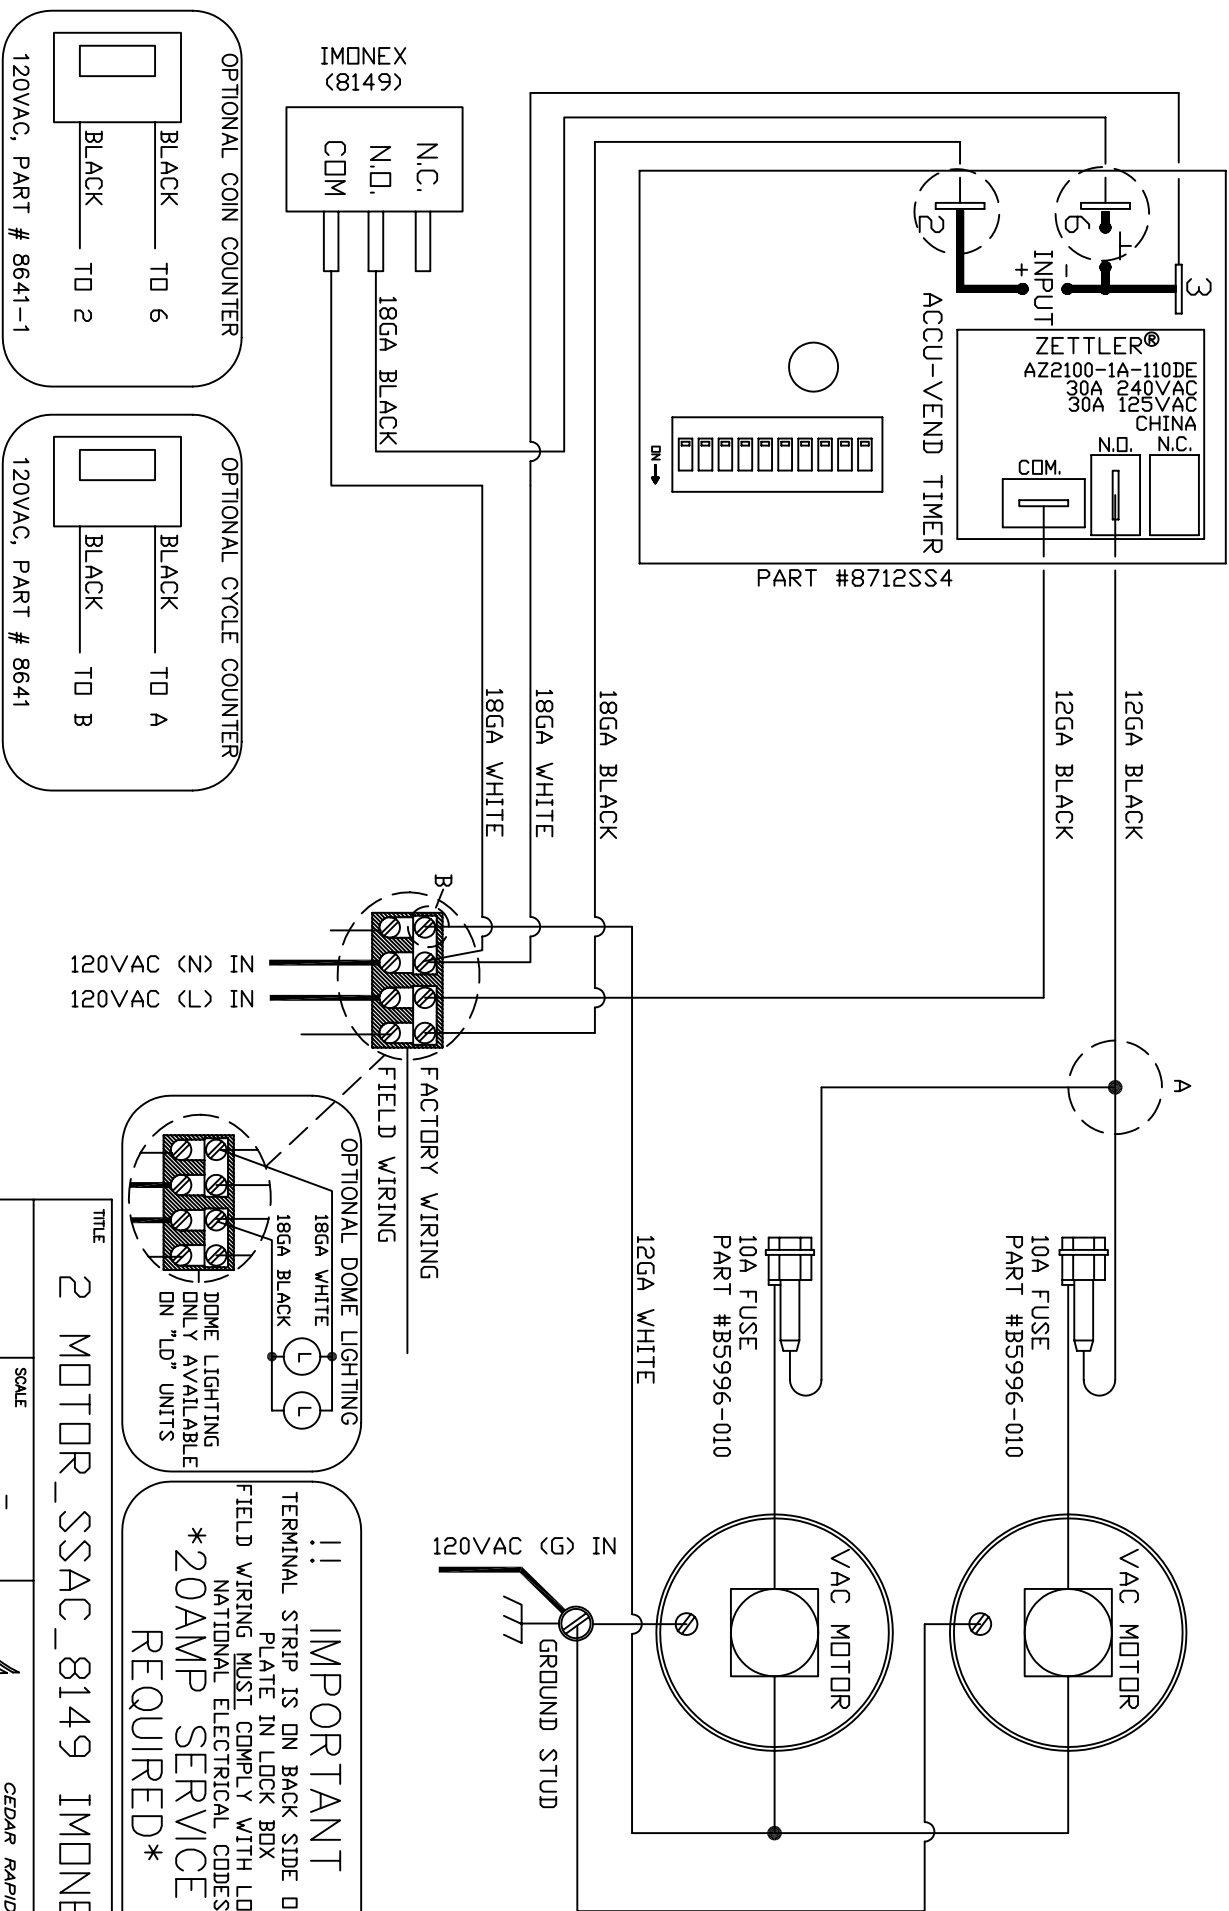

!! IMPORTANT !!
TERMINAL STRIP IS ON BACK SIDE OF TIMER
PLATE IN LOCK BOX
FIELD WIRING MUST COMPLY WITH LOCAL AND
NATIONAL ELECTRICAL CODES
*20AMP SERVICE IS
REQUIRED*

120VAC, PART # 8641-1		120VAC, PART # 8641		UNSPECIFIED TOLERANCES FRACT. $\pm 1/32$ 2 PL $\pm .020$ 3 PL $\pm .010$ ANGLE $\pm 1.0^\circ$		SCALE -	 CEDAR RAPIDS, IOWA
REV	NO.	DESCRIPTION	DATE	BY	REL. FOR PROD.	DRAWN BY CK DATE 4-30-10	